


6 5 4 3 2 1

D

C

B

A

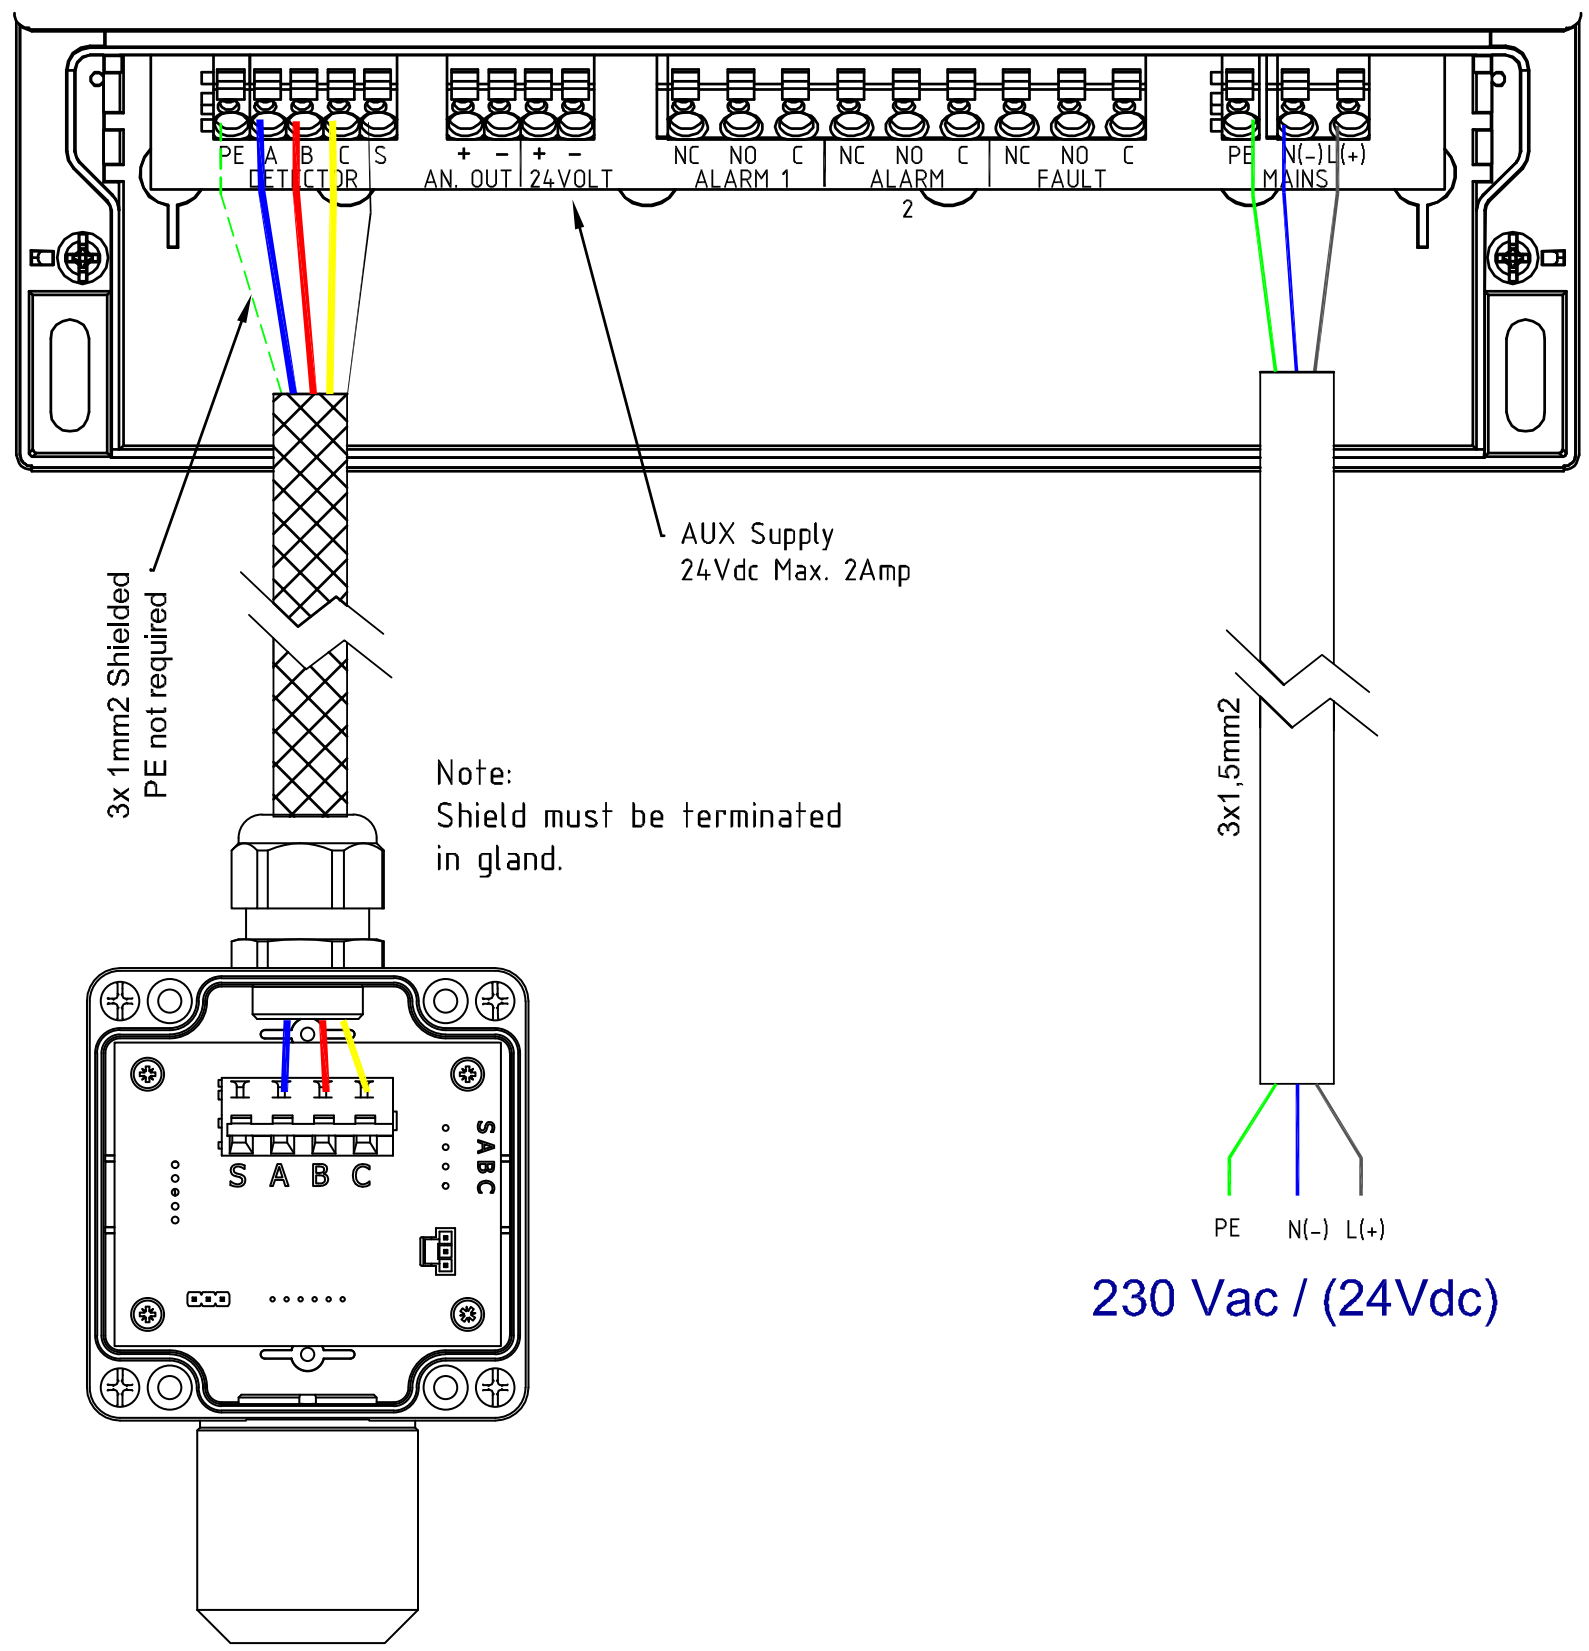

3x 1mm2 Shielded
PE not required

AUX Supply
24Vdc Max. 2Amp

Note:
Shield must be terminated
in gland.

3x1,5mm2

230 Vac / (24Vdc)

| | | | |
|---|------------------|---|------------------|
| Designed by JA | Checked by HP | DWG.No: EG00126E | Edition: A |
| geopal [®] Bygmarken 19 DK-3520 Farum Phone: +4545670600 | | Title: GJD-L3C 230Vac / 24Vdc Incl. GJ-ELK Detector | Scale: NA |
| | | | Sheet: 1 of 1 |
| Format: A3 | | | Date: 12-06-2025 |

6 5 4 3 2 1