

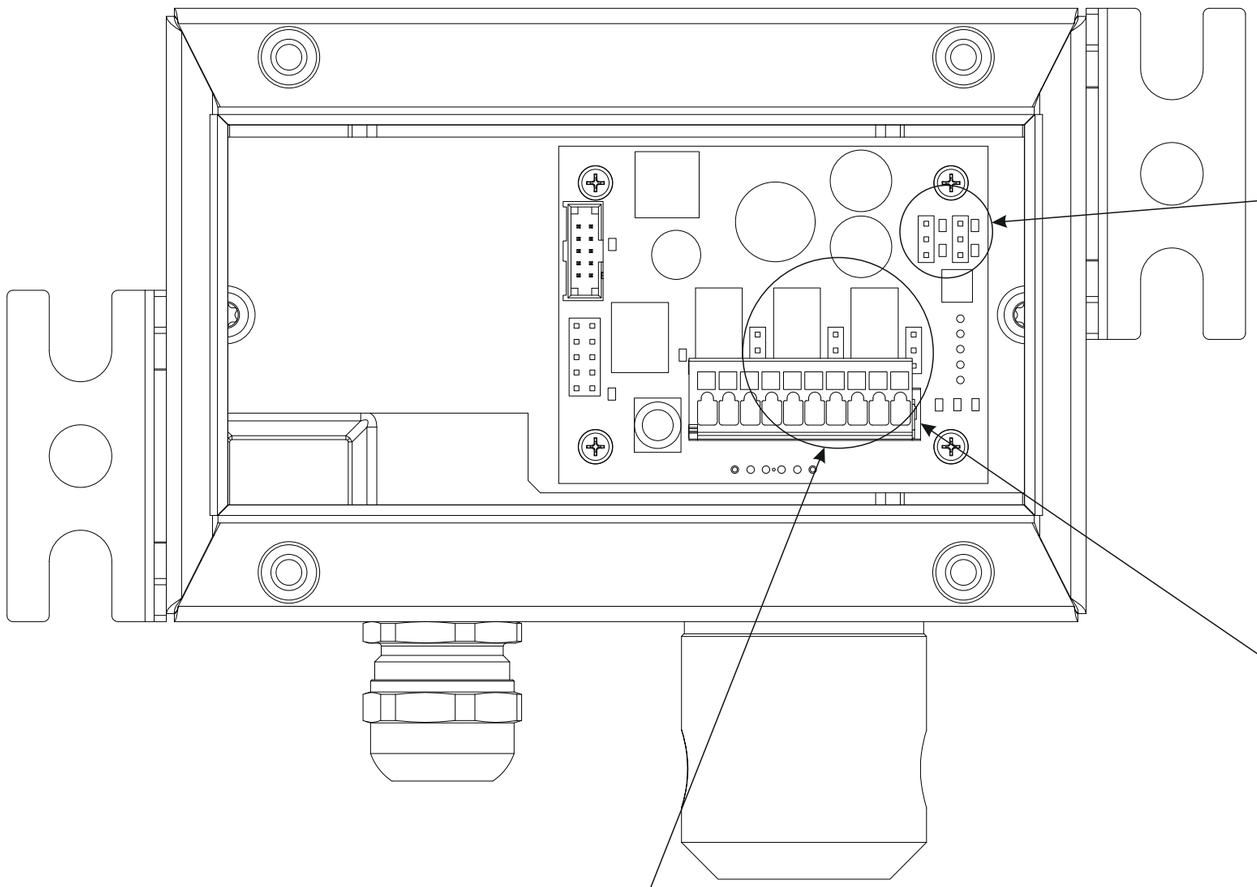


Analog Output
Jumper settings.

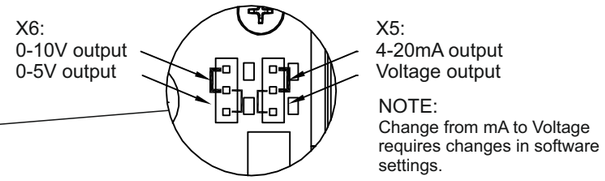


NOTE:
Change from mA to Voltage requires changes in software settings.

Relay Output
Jumper settings.

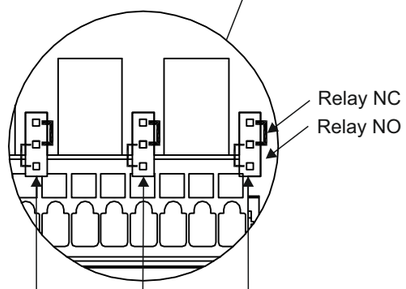

Analog Output

Power Supply
Not:
Shield must be terminated in Cable Gland

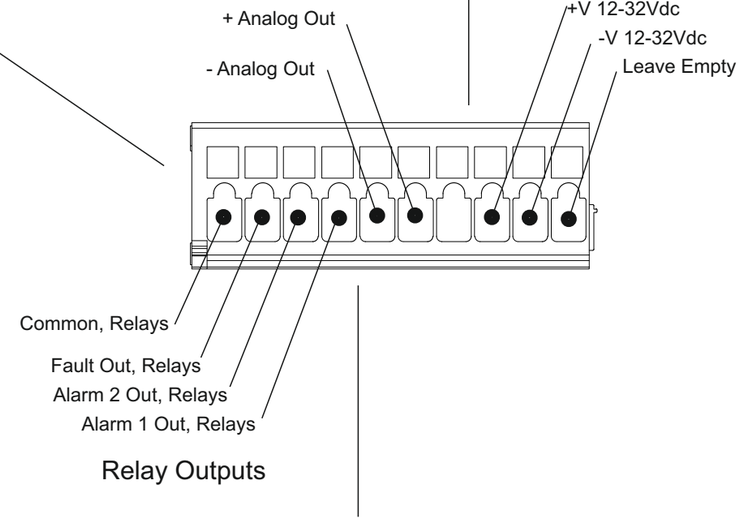

Relay Outputs

Designed by: JA	Checked by: HP	DWG.No: EG02510	Edition: A
geopal® Bygmarken 19 DK-3520 Farum Phone: +4545670600		Title: Quick Guide DET-1204 GPM-SA1SS	Scale: :
			Sheet: 1 of 1
Filename: EG02510 GPM-SA1SS RevA		Format: A3	Date: 11-06-2025